

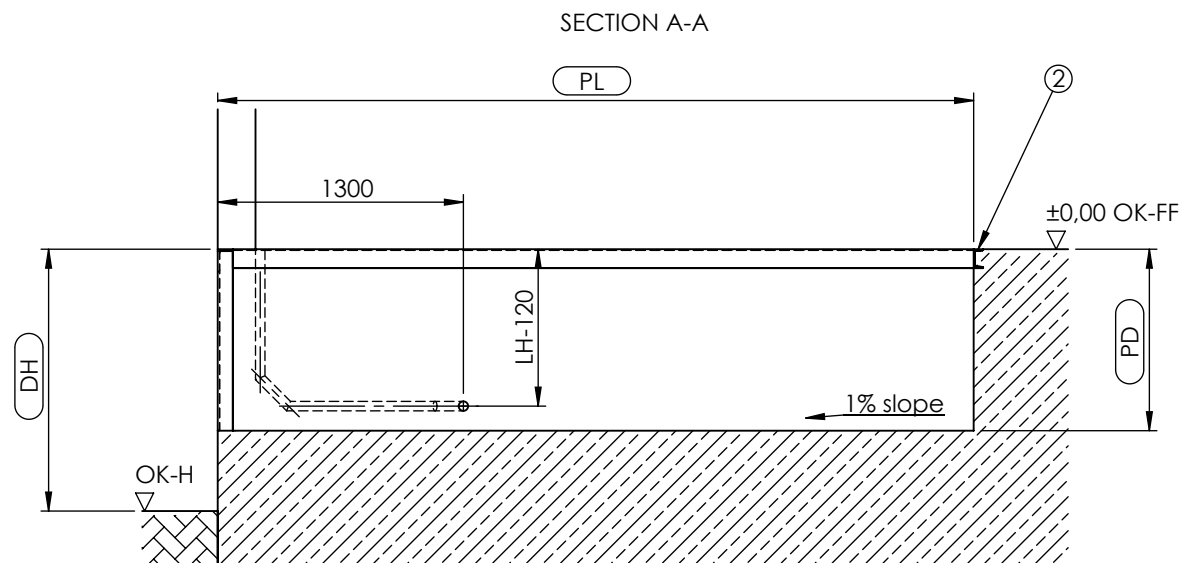
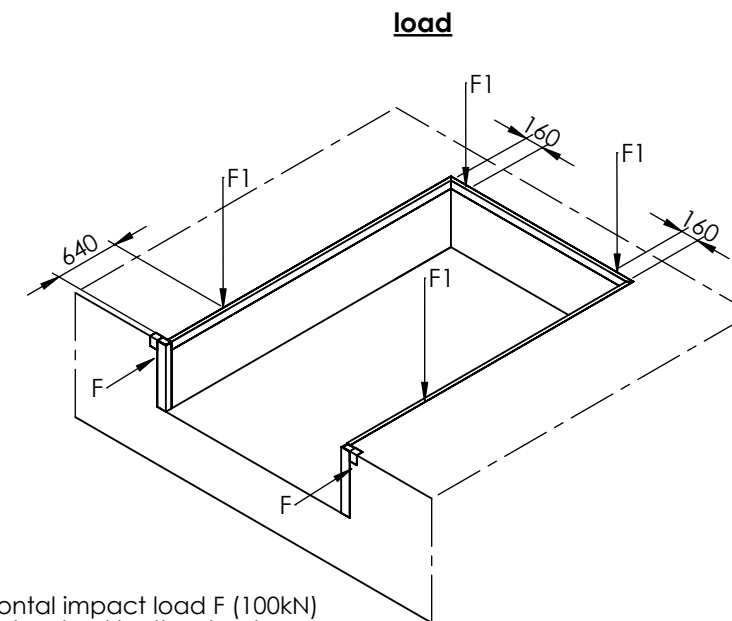


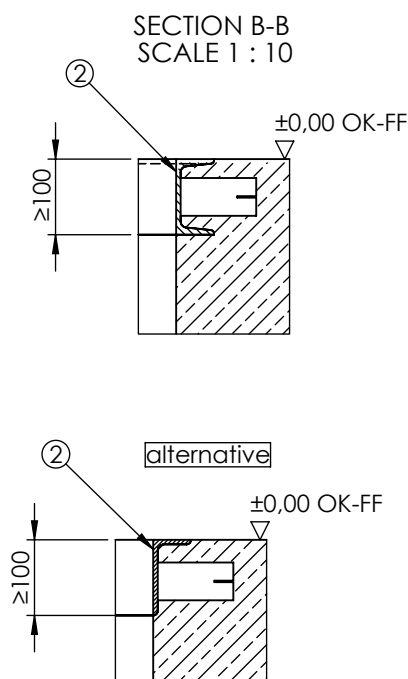

load capacity	F1
60 kN	57 kN

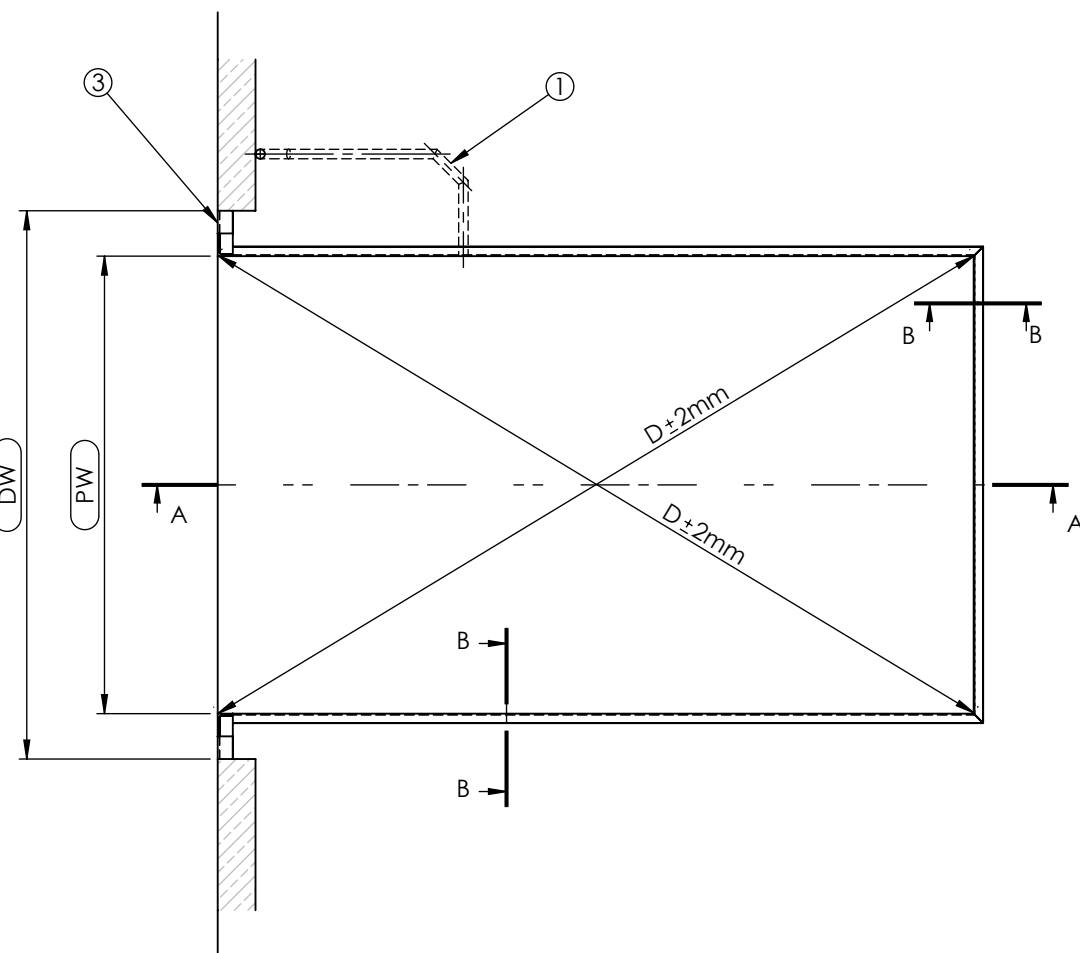

F = The horizontal impact load F (100kN) must be absorbed by the structure.
F1= cross traffic position

Placement of the conduits: either on the right or on the left side.
Illustration: installation on the right side

DH	Dock height	by others
DW	Door width	1 -Conduit for wiring internal diameter min. 50mm
OK-FF	Finish floor level	angles <45°
OK-H	Yard level	2 -Cast in frame
PL	Pit lenght	3 -Steel profile e.g. angle 120x80x10
PW	Pit width	
PD	Pit depth	
NL	Nominal lenght	Attention
NW	Nominal width	-Do not deviate from the measurements given
LH	Leveller height	-The corners of the pit must be square (diagonals must be equal)
		-The preparation of the pit and the dowels by other

NL	3000	3500	4000	4500
LH	800	900	950	950
PL	2985	3485	3985	4485
PD	810	910	960	960

NW	PW
2000	2020
2200	2220
2250	2270
2400	2420

Installation place drawn: NL=4000
NW=2400
LH=950

DIMENSIONS ARE IN MILLIMETERS						DO NOT SCALE DRAWING		REVISION E	
						MATERIAL:			
	NAME	SIGNATURE	DATE	 PJP MAKRUM Industrial Group PJP MAKRUM S.A. Plac Kościeleckich 3 85-033 Bydgoszcz POLAND		TITLE: PTU F without tail lift			
DRAWN	R. Śluszczyk	22.05.2023							
CHK'D									
APPV'D									
MFG									
Q.A									
			DWG NO. PTU.00.00.05-EN			A3			
			WEIGHT:		SCALE:1:50	EN			